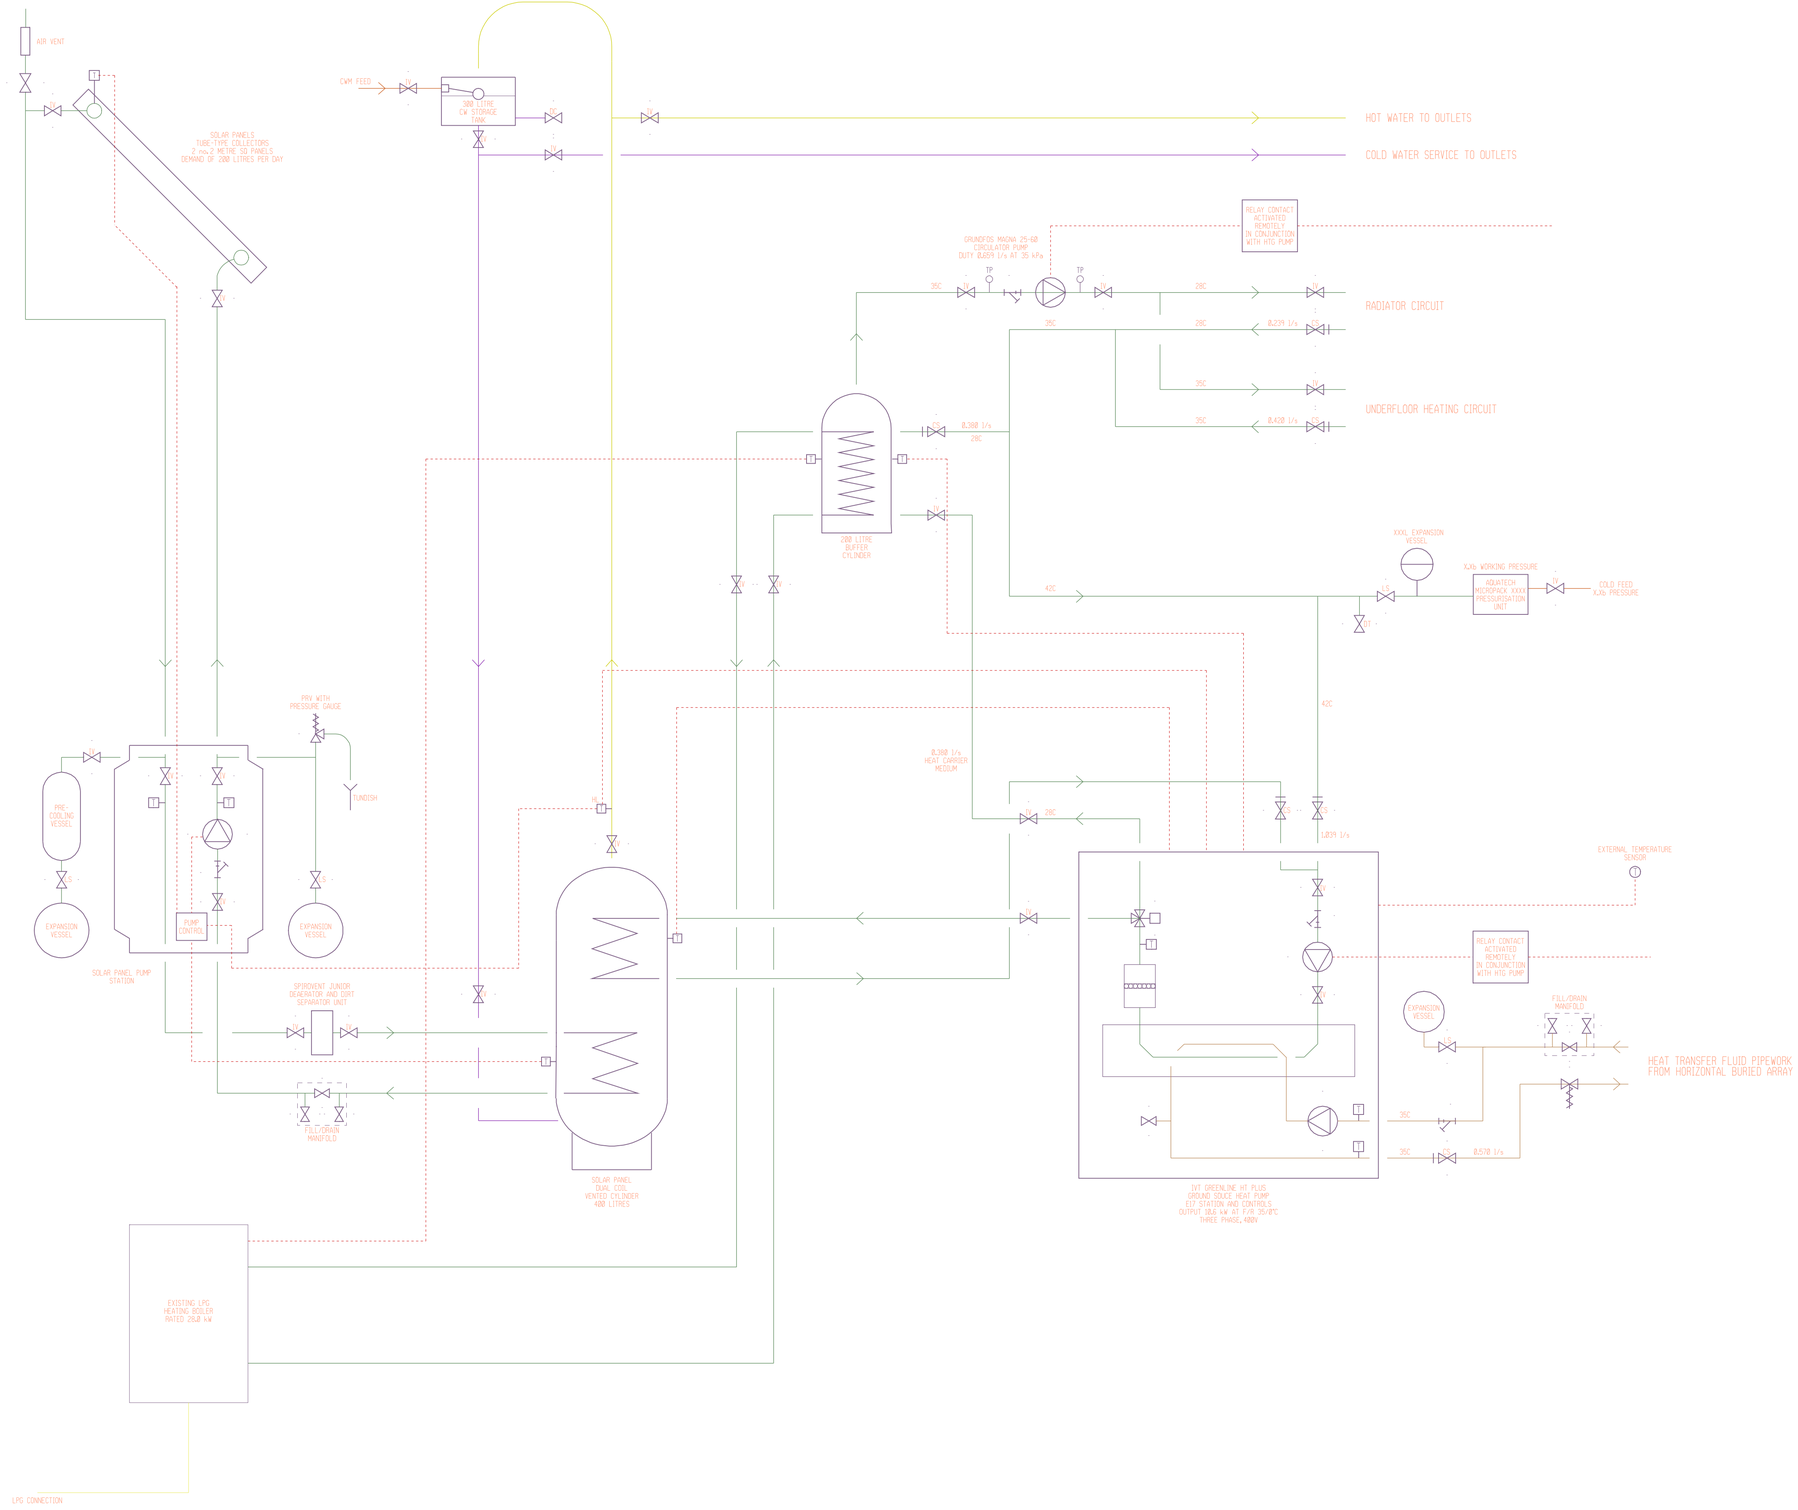

KEY

- NEW PIPEWORK/PLANT
- EXISTING PIPEWORK/PLANT
- ISOLATING VALVE
- LOCKSHIELD VALVE
- COMMISSIONING SET
- DRAIN TAP
- STRAINER
- TEMPERATURE SENSOR
- BINDER TEST POINT
- MIXING VALVE
- SAFETY VALVE

NOTES

1. ASSUMED FLOW/RETURN TEMPERATURES FOR RADIATOR AND UNDERFLOOR HEATING CIRCUITS 35/28.8°C AS ADVISED BY UNDERFLOOR HEATING SPECIALIST
2. SOLAR WATER HEATING PLANT SIZING BASED ON RECOMMENDATIONS BY VIESSMANN LTD AND WORCESTER BOSCH LTD

REVISION	DATE	CHK BY	NO

TITLE: HEATING PLANT SCHEMATIC
MECHANICAL SERVICES

PROJECT: BRYN SIRIOL

ARCHITECT:

SCALE AT A1: NTS
DRAWN: OAG
CHECKED: MRD
DATE: JUN07

ENGDESIGN
106-108 BERMONDSEY STREET
LONDON SE1 3TX
TELEPHONE 020 7357 7223
FACSIMILE 020 7357 7301

2263-5-1