

15.03.2007


TRIAL PITS

NOTES

- 1) will need to dig around INSULATE INCOMING WATER MAIN or carefully dig around & under it *are we??
- 2) ditto for Lpg supply IF retained for "emergency" use!!

Ann. Eated again: 15/03/2007

with SUGGESTED possible, TRIAL PITS for slinky suggested locations. Each pit 1x1x1m??
 Note This leaves clear route for all water drains.

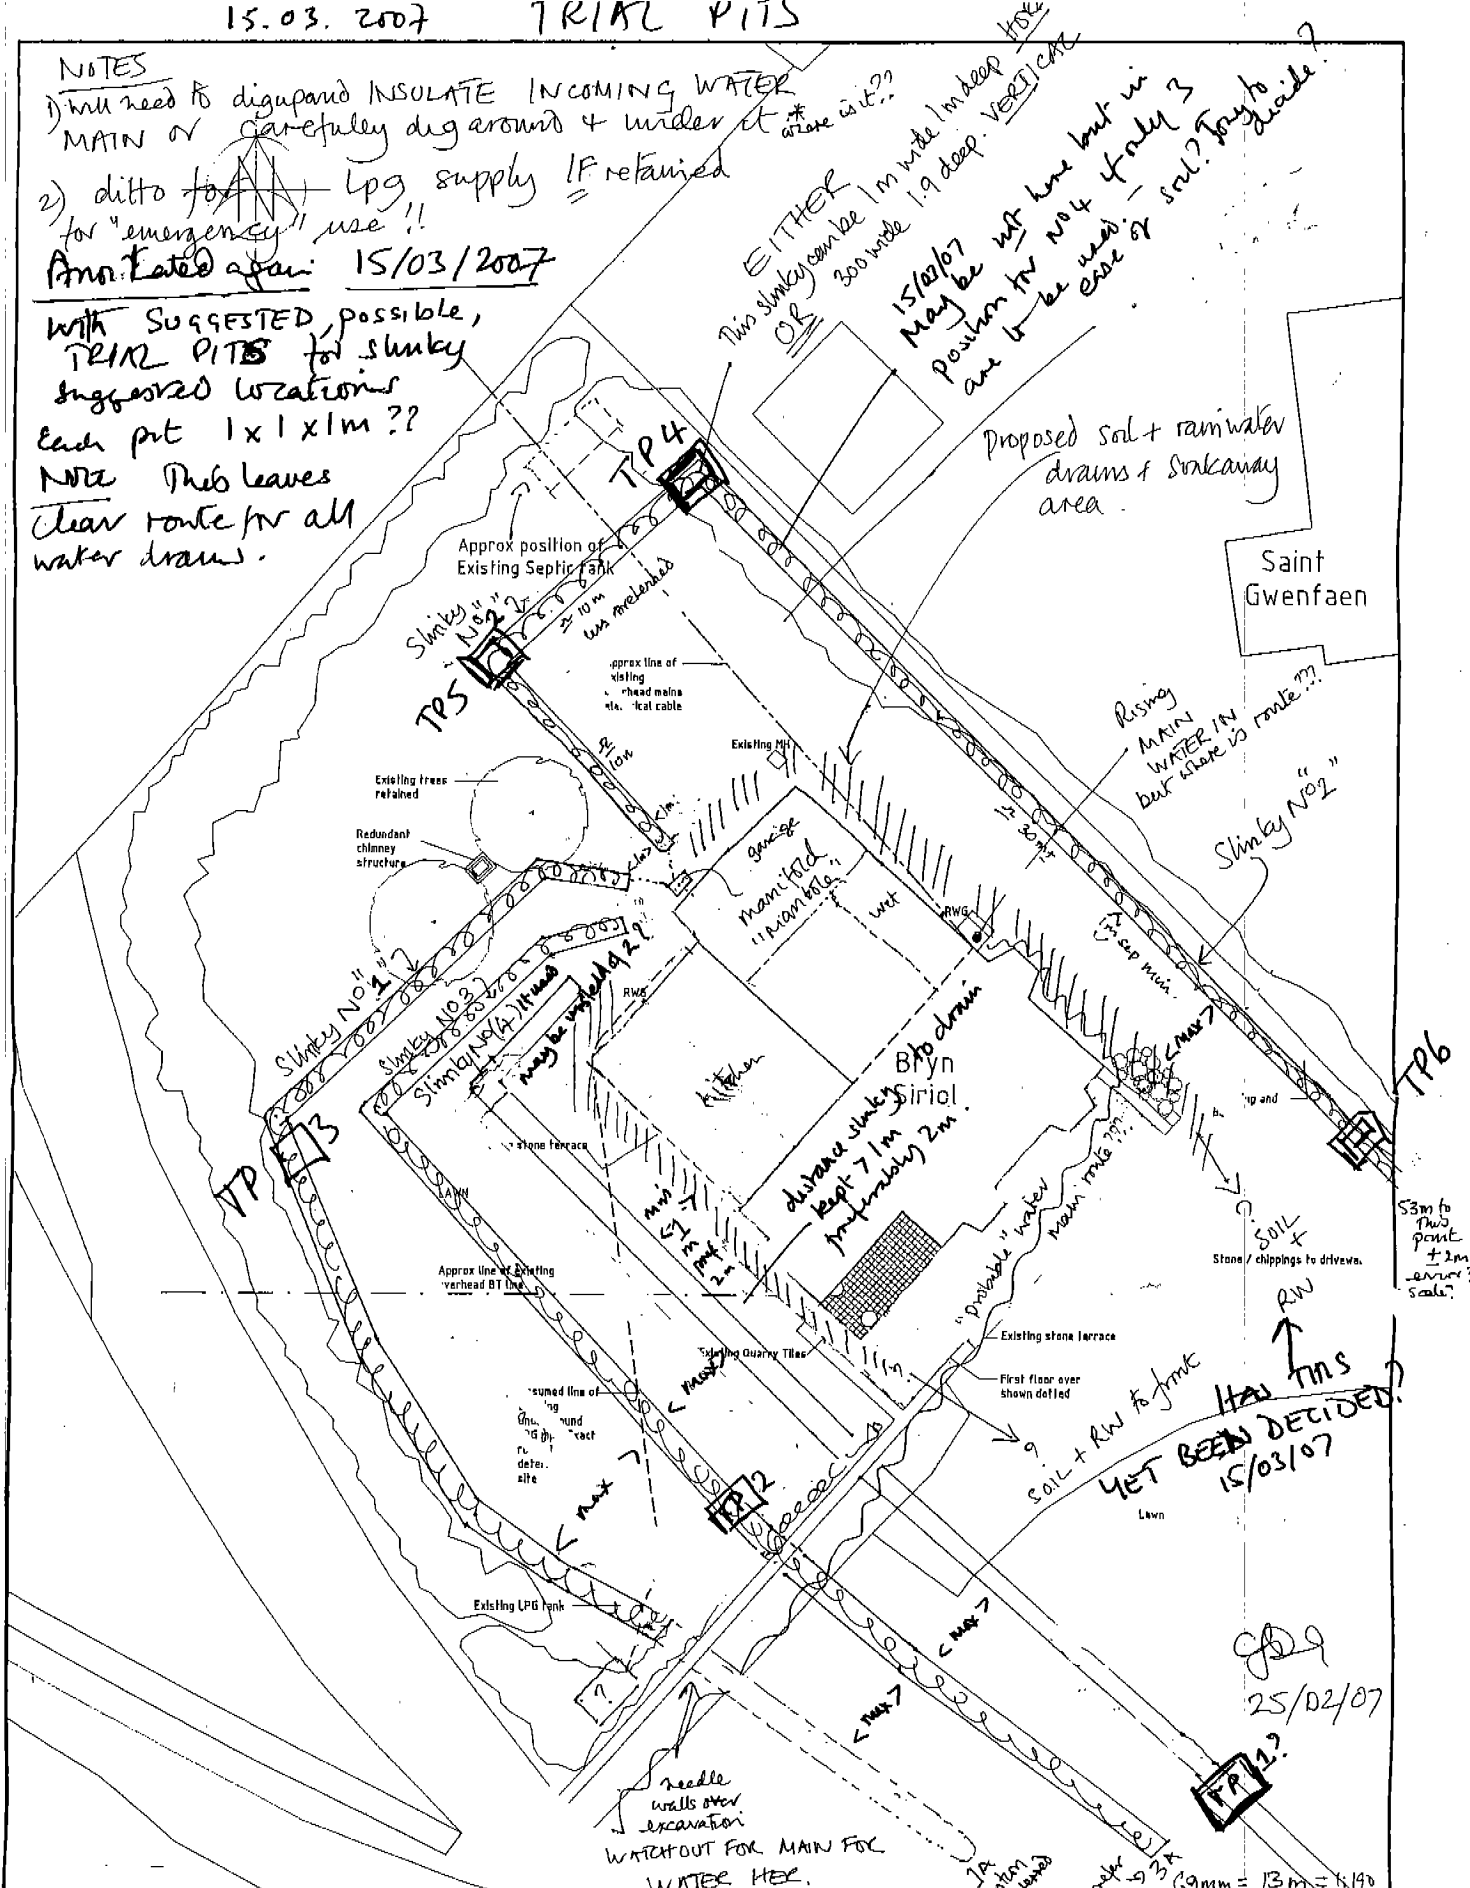

© This drawing is copyright of Pritchard Bond Architects and must not be copied or reproduced in any format in whole or part thereof without written consent.



PRITCHARD BOND ARCHITECTS

ISHANT, GLYNNE ROAD
 BANGOR, GWYNEDD, LL57 1AH
 Tel: 01248 362346 Fax: 01248 353786

CHARTERED ARCHITECTS / PENSEIRI SIARTREIDIG

CLIENT

Dr S Hart

PROJECT TITLE

Layout of slinky + trenches. preferred options
 Proposed extension and alteration to 1, 2, 3
 Bryn Siriol, Rhoscolyn, Anglesey. Decision to be based on practicality

DRAWING TITLE

EXISTING SITE PLAN

or excavation by
 and/or Tony.

SCALE

1:1902

1:200

DRAWN

DATE

AMC

22-08-05

DWG No.

2799 / 09